


**WATER LEGEND**

- W- WATER LINE (SIZE SHOWN)
- ◆ FIRE HYDRANT ASSEMBLY W/GATE VALVE & TEE
- ◆ GATE VALVE
- ◆ WATER SERVICE LATERAL W/METER
- ◆ BLOW-OFF VALVE

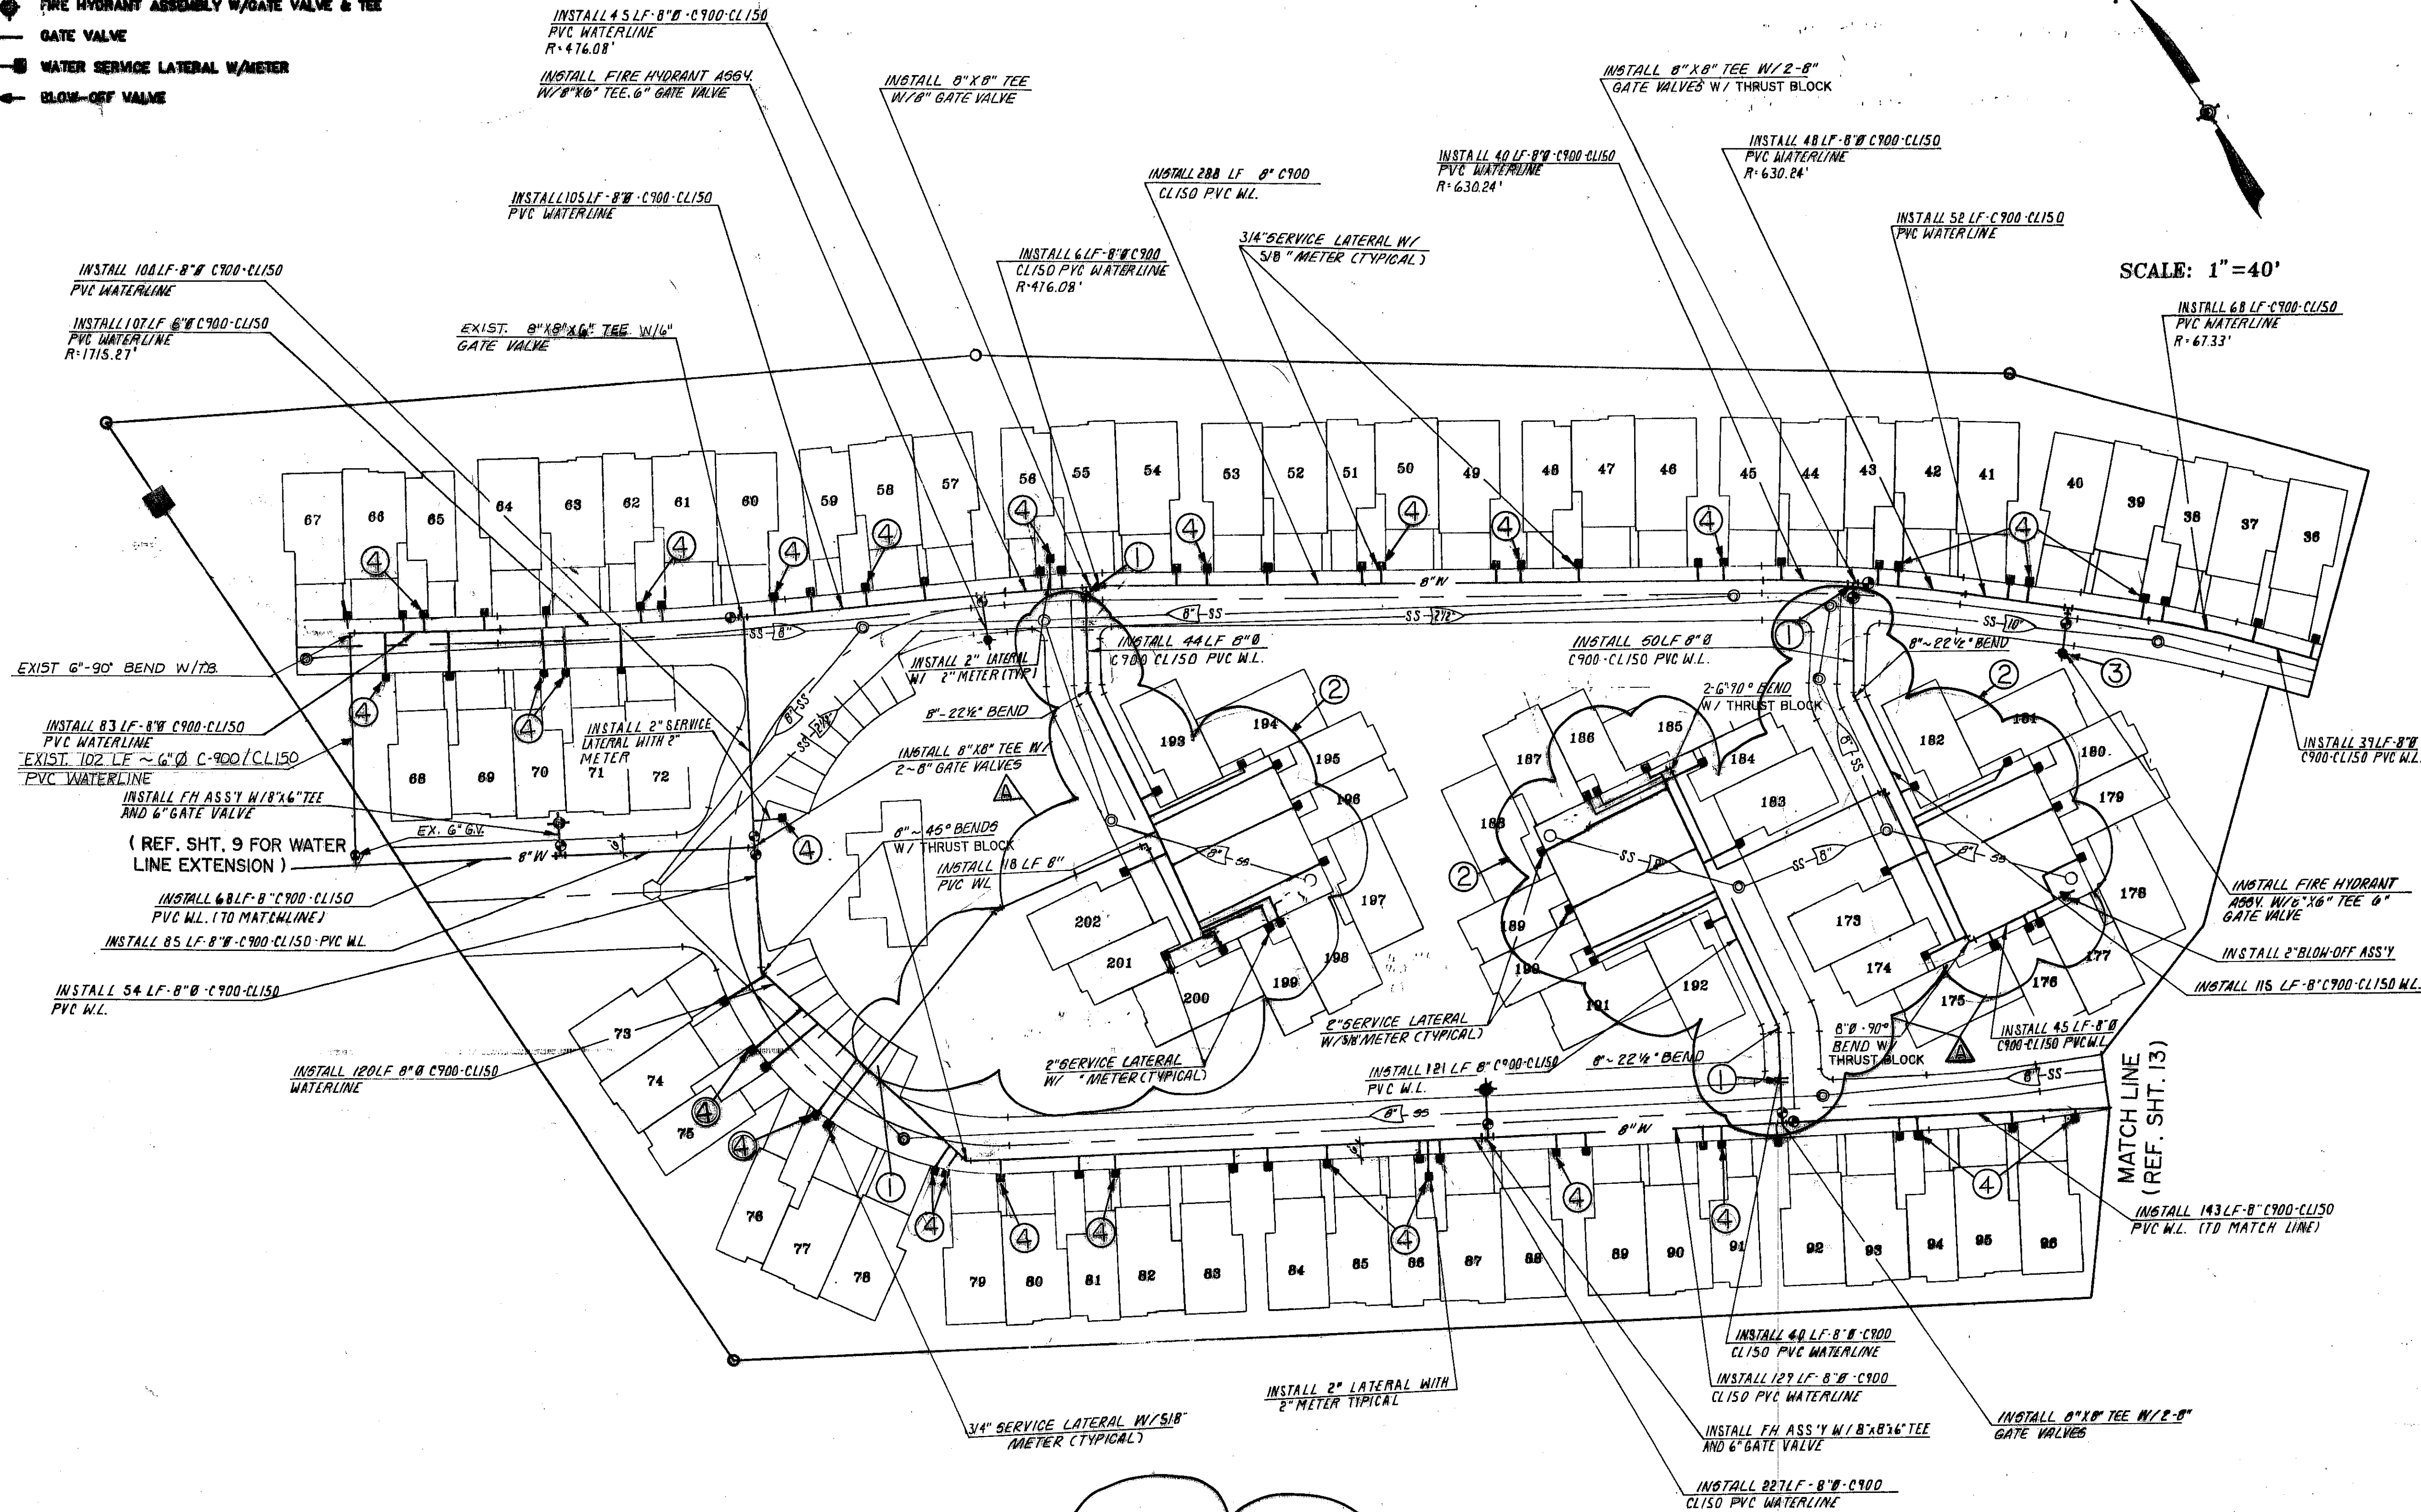

SCALE: 1"=40'

**SUMMIT**  
ENGINEERING CORPORATION  
CONSULTING ENGINEERS AND SURVEYORS  
111 EAST WEND AVENUE, SUITE 22, LAS VEGAS, NEVADA 89102  
PHONE: (702) 734-1800  
FAX: (702) 734-0624



DESIGNED BY: A.S.M.  
DRAWN BY: K.K.A.  
CHECKED BY: J.T.A.  
DATE: SEPT. 1994

EXISTING WATER PLAN (REMOVAL)  
PORTOBELLO  
KAHALA DEVELOPMENT

**CONSTRUCTION NOTES**

- ① INSTALL BLIND FLANGE PER-DETAIL 'B' AS SHOWN ON SHEET 12 OF 15
- ② REMOVE ALL WATER IMPROVEMENTS INCLUDING 8" PVC WL, BENDS, B.O., LATERALS, METERS, & THRUST BLOCKS.
- ③ RELOCATE EXISTING FIRE HYDRANT AS SHOWN ON SHEETS 14 AND 15
- ④ CLOSE CORP. STOP @ EXIST. WATER LAT. REMOVE WATER METER, DETACH AND LEAVE EXIST. LATERAL IN PLACE.

NOTES:  
1. PROVIDE THRUST BLOCKS TO ALL WATER LINE BENDS EXCEPT 11-1/4° BENDS  
2. ALL WATER SERVICE LATERALS WILL BE 3/4" LINE WITH 5/8" METER SET UNLESS SHOWN OTHERWISE.

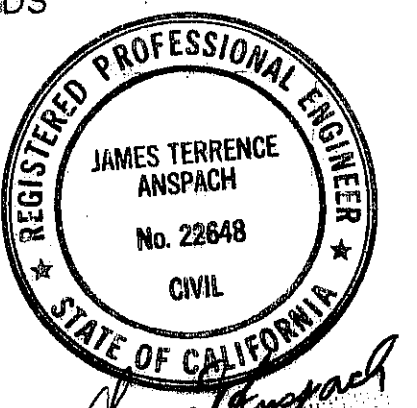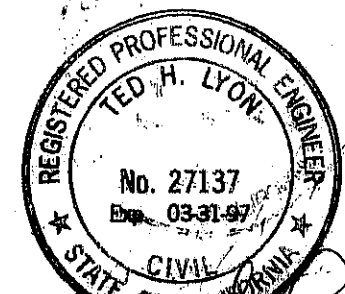

BY	DATE	DESCRIPTION
ASH	9/29/94	REMOVE EXISTING FACILITIES

SCALE: HORIZ. 1"=40'  
VERT. 1"=10'  
SHEET 11 OF 15  
JOB NO. 708631

DRA K-2